


WATERFLOW ALARM VALVE SYSTEM

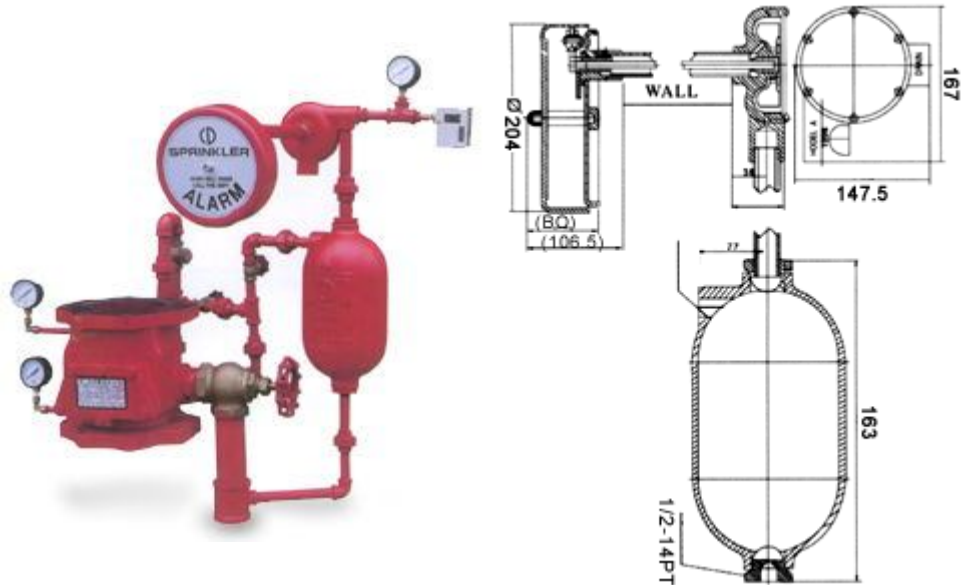

- ④ AVD 911A 4" Model A flanged end vertical installed alarm check valve
 - ④ AVD 941A 6" Model A flanged end vertical installed alarm check valve
 - ④ The valve is made in accordance with UL 193 Alarm Valves for fire-protection service
 - ④ Material cast iron ASTM A48 class No35
 - ④ Rated pressure 175psi, test pressure 350psi
 - ④ Marking UL LISTED 3S58 A 175psi 4"/6" ALARM CHECK VALVE
 - ④ Installation flange dimensions ANSI B16.1 class 125/ANSI B16.5 class 150
 - ④ AVD1911N Model A retard chamber, which is made in accordance with UL193.
 - ④ Material cast iron ASTM A48 class No35
 - ④ Marking UL LISTED 3S58 RETARD CHAMBER MODEL A
 - ④ Installation vertical 1/2 NPT(PT) thread female inlet 3/4 NPT(PT) female thread outlet and 1/2 NPT(PT) female thread drain
 - ④ AVD2911N Model A water motor gong, which is made in accordance with UL193.
 - ④ Material water motor aluminum alloy ASTM B26 356.0, gong shell aluminum alloy ASTM B209 6061
 - ④ Marking UL MODEL A DRAIN on water motor.
- SPRINKLER ALARM
 FIRE PROTECTION EQUIPMENT CHANG DER
 FIRE PROTECTIONS CORP. WHEN BELL RINGS
 CALL FIRE DEPT on gong shell.